ANALYTICAL RESEARCH LABS, INC.
2225 W. Alice Ave. • Phoenix, AZ 85021 USA • (602) 995-1580

PATIENT NAME:

SEX:	AGE:	DATE:	LAB NO.	CLIENT ACCT. NO.
M	26	4/25/08	420639	81788

NUTRIENT MINERALS

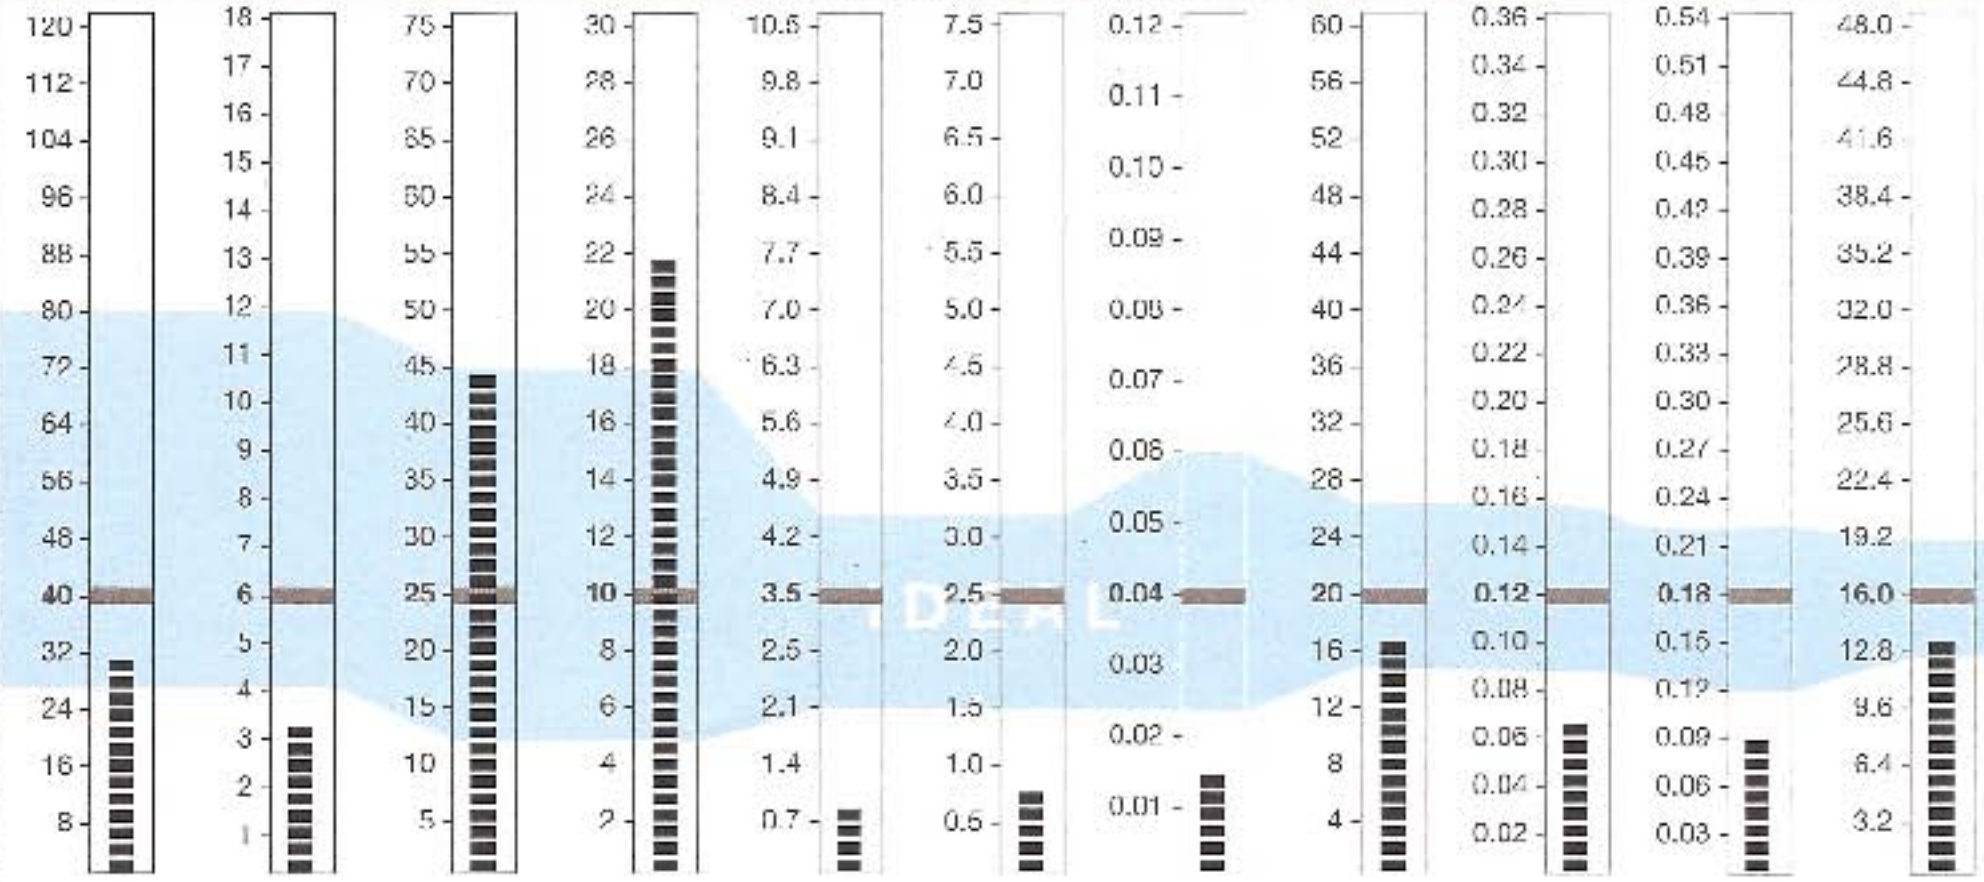

CALCIUM (Ca)	MAGNESIUM (Mg)	SODIUM (Na)	POTASSIUM (K)	IRON (Fe)	COPPER (Cu)	MANGANESE (Mn)	ZINC (Zn)	CHROMIUM (Cr)	SELENIUM (Se)	PHOSPHORUS (P)
30.0	3.0	44.0	22.0	0.9	0.8	0.015	17.0	0.067	0.081	13.0
PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST

TOXIC METALS

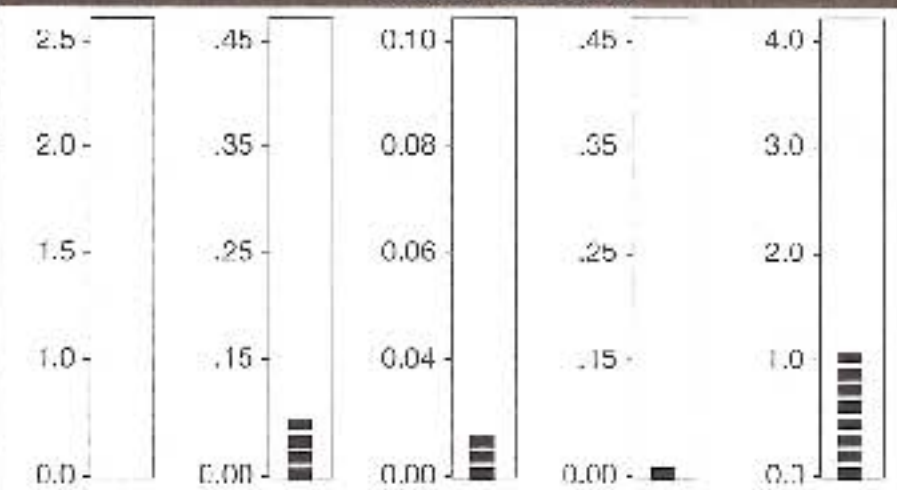

LEAD (Pb)	MERCURY (Hg)	CADMIUM (Cd)	ARSENIC (As)	ALUMINUM (Al)
0.008	0.076	0.019	0.016	1.12
PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST

ADDITIONAL MINERALS

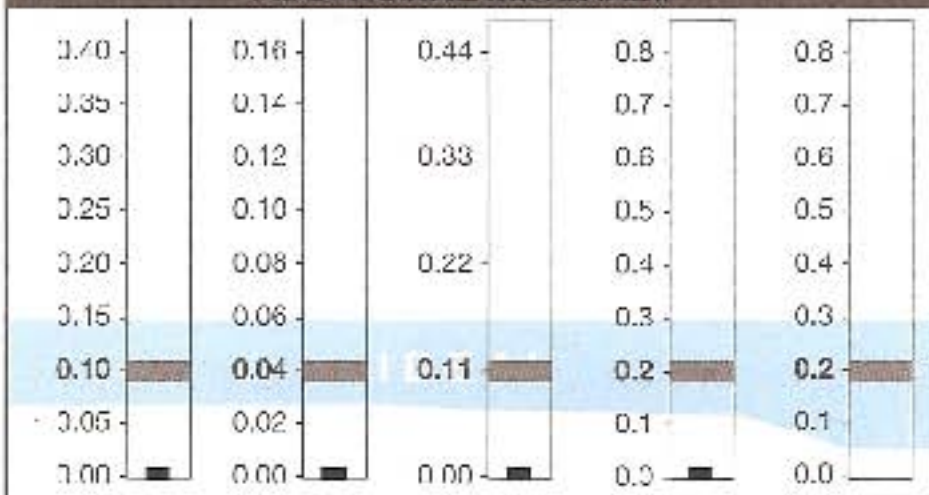

NICKEL (Ni)	COBALT (Co)	MOLYBDENUM (Mo)	LITHIUM (Li)	BORON (B)
0.005	0.001	0.003	0.00	N/A
PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST	PREVIOUS TEST

SIGNIFICANT MINERAL RATIOS

MINERAL RATIO	IDEAL RATIO	CURRENT RATIO	% OF IDEAL	PREVIOUS RATIO	LOW	IDEAL	HIGH
CA/MG	6.67	10.00	150		○○○○○○○○○○	○○○	○○○○○○○○○○
CA/K	4.00	1.36	34		○○○○○○○		
NA/MG	4.17	14.67	352		○○○○○○○○○○	○○○	○○○○○○○○○○
NA/K	2.50	2.00	80		○○○○○○○○○○		
ZN/CU	8.00	21.25	266		○○○○○○○○○○	○○○	○○○○○○○○○○
CA/P	2.50	2.31	92		○○○○○○○○○○		

MIXED OXIDIZER [ ] FAST OXIDIZER [***] SLOW OXIDIZER [ ]

NA = NOT AVAILABLE REPORTED IN Mg/% Testing by ACCUTRACE LABORATORIES, INC. • CLIA# 03D0611683 • Phoenix, AZ USA 85027 COPYRIGHT © 1981-2002 by ANALYTICAL RESEARCH LABORATORIES, INC. ARL-10 3/07